

# Frequency-Locked Loop Based Estimation of Single-Phase Grid Voltage Parameters

Ahmed, H., Amamra, S-A. & Bierhoff, M

Author post-print (accepted) deposited by Coventry University's Repository

**Original citation & hyperlink:**

Ahmed, H, Amamra, S-A & Bierhoff, M 2018, 'Frequency-Locked Loop Based Estimation of Single-Phase Grid Voltage Parameters' IEEE Transactions on Industrial <https://dx.doi.org/10.1109/TIE.2018.2873527>

DOI 10.1109/TIE.2018.2873527

ISSN 0278-0046

ESSN 1557-9948

Publisher: IEEE

**© 2018 IEEE. Personal use of this material is permitted. Permission from IEEE must be obtained for all other uses, in any current or future media, including reprinting/republishing this material for advertising or promotional purposes, creating new collective works, for resale or redistribution to servers or lists, or reuse of any copyrighted component of this work in other works.**

**Copyright © and Moral Rights are retained by the author(s) and/ or other copyright owners. A copy can be downloaded for personal non-commercial research or study, without prior permission or charge. This item cannot be reproduced or quoted extensively from without first obtaining permission in writing from the copyright holder(s). The content must not be changed in any way or sold commercially in any format or medium without the formal permission of the copyright holders.**

**This document is the author's post-print version, incorporating any revisions agreed during the peer-review process. Some differences between the published version and this version may remain and you are advised to consult the published version if you wish to cite from it.**

# Frequency-Locked Loop Based Estimation of Single-Phase Grid Voltage Parameters

Hafiz Ahmed, *Member, IEEE*, Sid-Ali Amamra, Michael Bierhoff, *Member, IEEE*

**Abstract**—Estimation of Amplitude, instantaneous phase and frequency of single-phase grid voltage signal have been studied in this paper. The proposed approach uses a novel circular limit cycle oscillator (CLO) coupled with frequency-locked loop (FLL). Due to the nonlinear structure of the CLO, the proposed frequency adaptive CLO technique is robust against various perturbations faced in the practical settings *e.g.* discontinuous jump of phase, frequency and amplitude. Global stability analysis of the CLO and local stability analysis of the frequency adaptive CLO has been performed. Experimental results demonstrate the effectiveness of the proposed technique over a very recent technique proposed in the literature.

## I. INTRODUCTION

**A**MPLITUDE, phase and frequency are the fundamental parameters of single-phase grid signal. These fundamental parameters play significant role in various control, estimation, measurement and monitoring application in the context of smart grid [1], [2]. As a result, the estimation of these parameters is very important in the presence of various uncertainties (*e.g.* disturbance, non-smooth jumps) faced by the real-life electric power systems.

There are several widely accepted class of techniques available in the literature [3]–[16]. Frequency based techniques like discrete Fourier transform (DFT) or recursive DFT [5] can be used for parameter estimation. However, DFT suffers from spectral leakage while the recursive DFT may be subject to accumulation error. Least squares (LS) and its variants like weighted or recursive LS [8] are also found in the literature. LS can not handle singular matrix while for weighted LS exact knowledge of the weights are required. Kalman filter (KF) is another technique that can be used for the grid voltage parameter estimation [6]. However, prior knowledge of the covariance matrix is required. Moreover, it is computationally burdensome for low-cost real-time computing hardware.

Another popular class of technique is the well known phase-locked loop (PLL). PLL and its various variants [4], [7], [17] are widely used in the literature and successfully applied in various practical applications. PLLs are computationally simple, easy to tune and can provide accurate estimate of the time varying parameters. Classical PLL algorithms suffer in

unbalanced condition and the fast dynamic response generally comes at a cost of accuracy. Enhanced PLL (EPLL) [4] overcome these limitations but at a higher computational cost than the classical PLL.

Recently two nonlinear techniques namely second order generalized integrator frequency-locked loop (SOGI-FLL) [7] and adaptive notch filter (ANF) [9] became very popular. These methods have good performance however they suffer during voltage swells and sags. Although these techniques are nonlinear in nature but they are initial condition dependent. The main fundamental building block of these methods rely on the linear harmonic oscillator. Linear oscillators are not structurally stable as such small perturbation may change the equilibrium. Moreover, the oscillation amplitude is initial conditions dependent. For global stability analysis of various variants of FLL based technique, please consult [13], [14]. To overcome the limitations of linear oscillator based methods, nonlinear oscillator as the main building block can be useful. This has been explored in [10]. However, [10] can't estimate the amplitude in the presence of discontinuous amplitude jumps.

In this article, we propose the application of a novel nonlinear circular limit cycle oscillator (CLO) to estimate the fundamental parameters of the single-phase grid voltage signal. The special feature of this oscillator is that it has an almost globally asymptotically stable closed orbit in the phase-plane. This makes the proposed technique global *i.e.* its convergence doesn't depend on the initial conditions. This is a considerable advantage over the existing literature. However, the circular limit cycle oscillator is not frequency adaptive. To overcome this limitation, we couple the CLO with the FLL technique proposed in [7]. The coupled system works on a wide range of initial conditions for the FLL part and for any initial conditions for the CLO part.

The rest of the article is organized as follows: Section II gives the details of the proposed technique while the experimental results are given in Section III. Finally, Section IV concludes this article.

## II. PROPOSED TECHNIQUE

### A. Basics of Circular Limit Cycle Oscillator

In the phase-plane analysis of second-order nonlinear systems, some time an isolated periodic trajectory can be observed. This isolated periodic trajectory is known as limit cycle. The existence of a stable limit cycle implies sustained robust oscillation. This is a considerable advantage over linear harmonic oscillator which is not structurally stable. Circular-LCO (CLO) are a special type of LCO where the shape of

H. Ahmed is with the School of Mechanical, Aerospace and Automotive Engineering, Coventry University, The Futures Institute, Coventry CV1 2TL, United Kingdom. Corresponding author: H. Ahmed, E-mail: ac7126@coventry.ac.uk, Tel: +44-2-477650023.

S.-A. Amamra is with the Warwick Manufacturing Group (WMG), University of Warwick, Coventry, United Kingdom.

M. Bierhoff is with the Faculty of Electrical Engineering, University of Applied Sciences 18435, Stralsund, Germany.

the limit cycle is circular and independent of the oscillator parameters. In this work, we propose the following CLO model adapted from [18],

$$\dot{x} = y\omega_n \quad (1a)$$

$$\dot{y} = -x\omega_n - y(x^2 + y^2 - 1) \quad (1b)$$

where  $x$  and  $y$  are the state variables and  $\omega_n$  is the angular frequency of the sustained oscillation. The solutions of the CLO are  $x(t) = -\cos(\omega_n t)$ ,  $y(t) = \sin(\omega_n t)$ . As the solution of  $y(t)$  is similar to the single-phase grid voltage signal, CLO (1) can be considered as a proxy of the grid voltage signal. Then using proper feedback mechanism, any change in the grid voltage parameters, can be easily tracked using model (1).

A particular feature of CLO (1) is that it has an unstable equilibrium which is the origin and an almost globally asymptotically stable limit cycle which is the circle of radius 1 denoted by  $x^2 + y^2 = 1$ . It means, any trajectory that originates anywhere in the phase-plane, will converge to the circle of radius 1 except the one at origin. To verify this claim, the instability of the origin and the almost global asymptotic stability (A-GAS) of the limit cycle need to be proved.

**Instability of the origin:** Through linearization of eq. (1) at the origin, it can be found that the eigenvalues are given by  $\frac{1}{2}(1 \pm \sqrt{1 - 4\omega_n^2})$ . This clearly demonstrates the instability as the real part is always positive.

**A-GAS of the limit cycle:** This property can be demonstrated by converting eq. (1) into polar coordinates. In polar coordinates,  $x = r\cos\theta$ ,  $y = r\sin\theta$  and  $\theta = \arctan(y/x)$ . Then the dynamics of CLO in polar coordinates are given by:

$$\begin{aligned} r\dot{r} &= x\dot{x} + y\dot{y} \\ \dot{r} &= -r\sin^2(\theta)(r^2 - 1) \end{aligned} \quad (2)$$

$$\begin{aligned} \dot{\theta} &= (y\dot{x} - x\dot{y})/r^2 \\ \dot{\theta} &= -\sin(\theta)\cos(\theta)(r^2 - 1) - \omega_n \end{aligned} \quad (3)$$

From eq. (2) and (3), we get that if  $r = 1$ , then  $\dot{r} = 0$  and  $\dot{\theta} = -\omega_n$ , which implies a clockwise circular limit cycle of radius 1 with angular frequency  $\omega_n$  like the grid signal angular frequency. The stability of the limit cycle can be proved by considering  $V = 0.5(x^2 + y^2 - 1)^2$  as a Lyapunov function [19]. Then the proof of A-GAS property is straightforward and avoided here for the purpose of brevity.

### B. Frequency Adaptive CLO for parameter estimation

Eq. (1) has A-GAS property which makes it a very suitable model for single-phase grid voltage parameter estimation. However, the angular frequency  $\omega_n$  is constant. As such, the CLO will face difficulty in the presence of varying grid frequency. To overcome this issue, a frequency adaptation property needs to be introduced. For this purpose, frequency-locked loop (FLL) [7] can be very useful. CLO coupled with FLL and feedback mechanism to introduce the actual grid voltage is given by:

$$\dot{x} = y\omega \quad (4a)$$

$$\dot{y} = -\alpha(y - \chi)\omega - x\omega - y(x^2 + y^2 - 1) \quad (4b)$$

$$\dot{z} = \beta(y - \chi)x\omega \quad (4c)$$

where  $\alpha, \beta$  are the positive gains,  $\omega = \omega_n + 2\pi z$  is the angular frequency with  $\omega_n$  denoting the nominal grid frequency,  $y - \chi$  denotes the estimation error of the grid signal by the CLO and the grid voltage signal  $\chi$  is given by:

$$\begin{aligned} \chi &= A_g \sin(\theta_g) \\ \dot{\theta}_g &= -\omega_g \end{aligned} \quad (5)$$

where  $A_g, \theta_g$  and  $\omega_g$  are the amplitude, instantaneous phase and frequency of the actual grid signal. Original CLO (1) oscillates at  $\omega_n$ , however, the frequency adaptive CLO oscillates with the actual grid frequency  $\omega_n$ , thanks to the feedback mechanism and the coupling of FLL. It is to be noted here that CLO (4) can't handle DC bias in its current form. To make the CLO DC bias robust, the DC bias can be considered as an additional state variable in (4) as used in [20]. This solves the problem of DC bias. Details are avoided here for space limitation.

In the steady state,  $-\alpha(y - \chi)\omega \rightarrow 0$ . Then the dynamics of eq. (4a) and (4b) are similar to the original CLO (1). As such the solutions are also similar i.e.  $x(t) = -A_g \cos(\theta_g)$  and  $y(t) = A_g \sin(\theta_g)$ . Then the following formula gives the frequency, phase and amplitude of the actual grid signal  $\chi$ :

$$\omega_g = \omega_n + 2\pi z \quad (6a)$$

$$\theta_g = \arctan\{y/(-x)\} \quad (6b)$$

$$A_g = x^2 + y^2 \quad (6c)$$

### C. Local analysis of frequency adaptive CLO

To analyze the local stability of the frequency adaptive CLO, in this Section, we would resort to the polar coordinates as in Section II-B. Prior to that, to couple the dynamics of the grid signal (5) into the frequency adaptive CLO (4), let us introduce the instantaneous phase error as:  $e_\theta = \theta - \theta_g$ . Then the dynamics of (4) and  $e_\theta$  in polar coordinates are given as:

$$\dot{r} = r\sin^2(e_\theta + \theta_g)(A^2 - 1) - \alpha e_{x_2 - \chi} \omega \sin(e_\theta + \theta_g) \quad (7a)$$

$$\dot{e}_\theta = \omega_g - \omega + \frac{\sin\{2(e_\theta + \theta_g)\}}{2(A^2 - 1)^{-1}} - \frac{\omega \cos(e_\theta + \theta_g)}{r(\alpha e_{x_2 - \chi})^{-1}} \quad (7b)$$

$$\dot{z} = \beta e_{x_2 - \chi} \omega r \cos(e_\theta + \theta_g) \quad (7c)$$

where  $e_{x_2 - \chi} = r\sin(e_\theta + \theta_g) - A_g \sin\theta_g$ . The desired equilibrium of eq. (7) is given by:

$$x^* = \{r = A = A_g, e_\theta = 0, z = (\omega_g - \omega_n)/2\pi\}$$

Without losing any generality, for the sake of computational simplicity, we assume that  $A_g = 1$ . Then the system matrix of eq. (7) linearized at the equilibrium is given by:



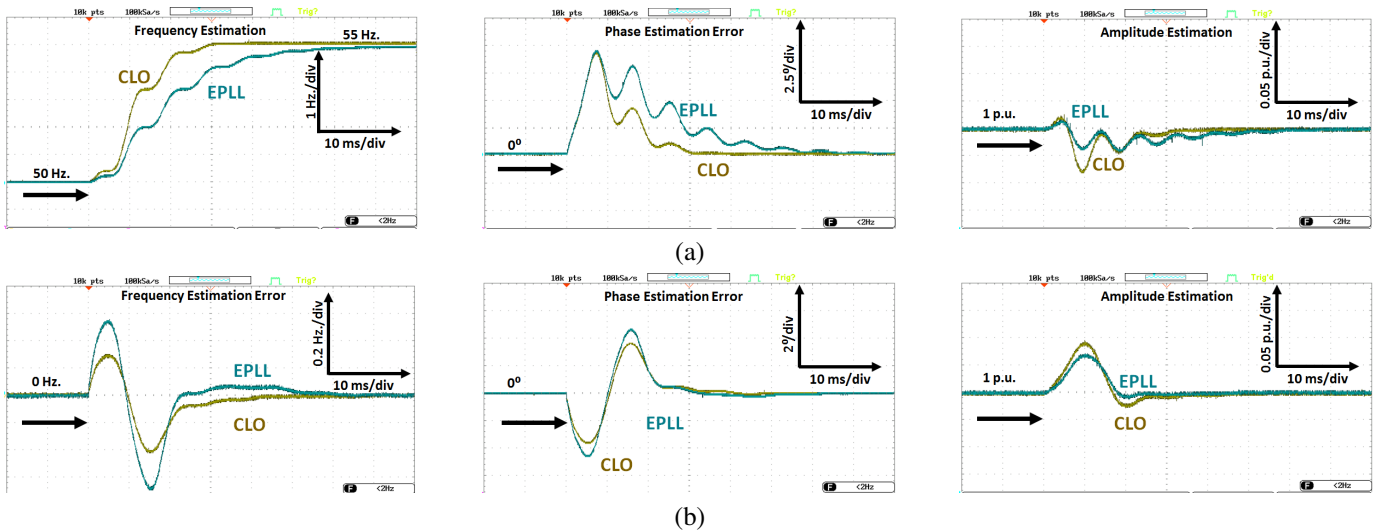


Figure 2. Experimental Results. (A): change in frequency from 50Hz. to 55Hz. (B): change of DC magnitude from 0 to 0.1p.u. Arrow indicates the time when change happens.

future research topic. The application of the proposed technique to various interesting areas *e.g.* grid synchronization is planned to be done in the future. In this work, we haven't considered rigorous mathematical analysis of the FLL part. This is also going to be considered in a future work.

## REFERENCES

- [1] N. Saxena, I. Hussain, B. Singh, and A. Vyas, "Implementation of grid integrated PV-battery system for residential and electrical vehicle applications," *IEEE Transactions on Industrial Electronics*, vol. 65, no. 8, pp. 6592 – 6601, 2018.
- [2] B. Singh, P. Shah, and I. Hussain, "ISOGI-Q based control algorithm for single stage grid tied SPV system," *IEEE Transactions on Industry Applications*, vol. 54, no. 2, pp. 1136 – 1145, 2017.
- [3] X. Cai, C. Wang, and R. Kennel, "A fast and precise grid synchronization method based on fixed gain filter," *IEEE Transactions on Industrial Electronics*, vol. 65, no. 9, pp. 7119 – 7128, 2018.
- [4] M. Karimi-Ghartemani, *Enhanced phase-locked loop structures for power and energy applications*. NJ, USA: John Wiley & Sons, 2014.
- [5] B. P. McGrath, D. G. Holmes, and J. J. H. Galloway, "Power converter line synchronization using a discrete fourier transform (DFT) based on a variable sample rate," *IEEE Transactions on Power Electronics*, vol. 20, no. 4, pp. 877–884, 2005.
- [6] S. Reza, M. Ciobotaru, and V. G. Agelidis, "Accurate estimation of single-phase grid voltage fundamental amplitude and frequency by using a frequency adaptive linear Kalman filter," *IEEE Journal of Emerging and Selected Topics in Power Electronics*, vol. 4, no. 4, pp. 1226–1235, 2016.
- [7] P. Rodríguez, A. Luna, I. Candela, R. Mujal, R. Teodorescu, and F. Blaabjerg, "Multiresonant frequency-locked loop for grid synchronization of power converters under distorted grid conditions," *IEEE Transactions on Industrial Electronics*, vol. 58, no. 1, pp. 127–138, 2011.
- [8] H.-S. Song and K. Nam, "Instantaneous phase-angle estimation algorithm under unbalanced voltage-sag conditions," *IEEE Proceedings-Generation, Transmission and Distribution*, vol. 147, no. 6, pp. 409–415, 2000.
- [9] D. Yazdani, A. Bakhshai, G. Joos, and M. Mojiri, "A nonlinear adaptive synchronization technique for grid-connected distributed energy sources," *IEEE Transactions on power electronics*, vol. 23, no. 4, pp. 2181–2186, 2008.
- [10] E. Oviedo, N. Vázquez, and R. Femat, "Synchronization technique of grid-connected power converters based on a limit cycle oscillator," *IEEE Transactions on Industrial Electronics*, vol. 65, no. 1, pp. 709–717, 2018.
- [11] Y. Han, M. Luo, X. Zhao, J. M. Guerrero, and L. Xu, "Comparative performance evaluation of orthogonal-signal-generators-based single-phase PLL algorithms-a survey," *IEEE Transactions on Power Electronics*, vol. 31, no. 5, pp. 3932–3944, 2016.
- [12] S. Golestan, J. M. G. GE, J. Vasquez, A. M. Abusorrah, and Y. A. Al-Turki, "Modeling, tuning, and performance comparison of advanced second-order generalized integrator-based FLLs," *IEEE Transactions on Power Electronics*, 2018.
- [13] X. He, H. Geng, and G. Yang, "A generalized design framework of notch filter based frequency-locked loop for three-phase grid voltage," *IEEE Transactions on Industrial Electronics*, vol. 65, no. 9, pp. 7072–7084, 2018.
- [14] G. Escobar, M. F. Martinez-Montejano, A. A. Valdez, P. R. Martinez, and M. Hernandez-Gomez, "Fixed-reference-frame phase-locked loop for grid synchronization under unbalanced operation," *IEEE Transactions on Industrial Electronics*, vol. 58, no. 5, pp. 1943–1951, 2011.
- [15] H. Ahmed, S. Amamra, and I. Salgado, "Fast estimation of phase and frequency for single phase grid signal," *IEEE Transactions on Industrial Electronics*, 2018.
- [16] N. Hui, D. Wang, and Y. Li, "A novel hybrid filter-based PLL to eliminate effect of input harmonics and DC offset," *IEEE Access*, vol. 6, pp. 19762–19773, 2018.
- [17] M. H. Bierhoff, "A general PLL-type algorithm for speed sensorless control of electrical drives," *IEEE Transactions on Industrial Electronics*, vol. 64, no. 12, pp. 9253–9260, 2017.
- [18] S. H. Strogatz, *Nonlinear dynamics and chaos: with applications to physics, biology, chemistry, and engineering*. Boca Raton, Florida: CRC Press, 2018.
- [19] H. Ahmed, R. Ushirobira, and D. Efimov, "Robust global synchronization of brockett oscillators," *IEEE Transactions on Control of Network Systems*, pp. 1–1, 2018.
- [20] M. Karimi-Ghartemani, S. A. Khajehodoin, P. K. Jain, A. Bakhshai, and M. Mojiri, "Addressing dc component in pll and notch filter algorithms," *IEEE Transactions on Power Electronics*, vol. 27, no. 1, pp. 78–86, 2012.